



- DRAWINGS ARE FOR PLANNING ONLY AND SHOULD NOT BE USED FOR DETAILED DESIGN, EQUIPMENT DIMENSIONS MAY CHANGE ONCE EXACT SPECIFICATIONS ARE DETERMINED;
- THE SUBSTATION IS BASED ON THE LATEST EIR GRID STANDARD (XDN-LAY-ELV-STND-F-001-R02 AS OF 13/02/2020);
- REFERENCE TO TABLE 4 FOR 220 kV IN THE XDS-GFS-00-001-R4 STANDARD.
 - Minimum height of bottom of unscreened bushings above ground = 2300mm.
 - Minimum height of live parts above pedestrian passageways = 4700mm.
 - Minimum height of live parts above vehicle passageways = 9000mm.
- THIS DRAWING IS NOT TO BE SCALED, ALL DIMENSIONS ARE IN METERS.

NO.	DATE	DESCRIPTION
P3	20/06/2023	FOR PLANNING
P2	09/11/2022	CLIENT COMMENTS
P1	19/09/2022	CLIENTS COMMENTS
P0	27/05/2022	FIRST ISSUE FOR PLANNING
I/R	DATE	DESCRIPTION


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

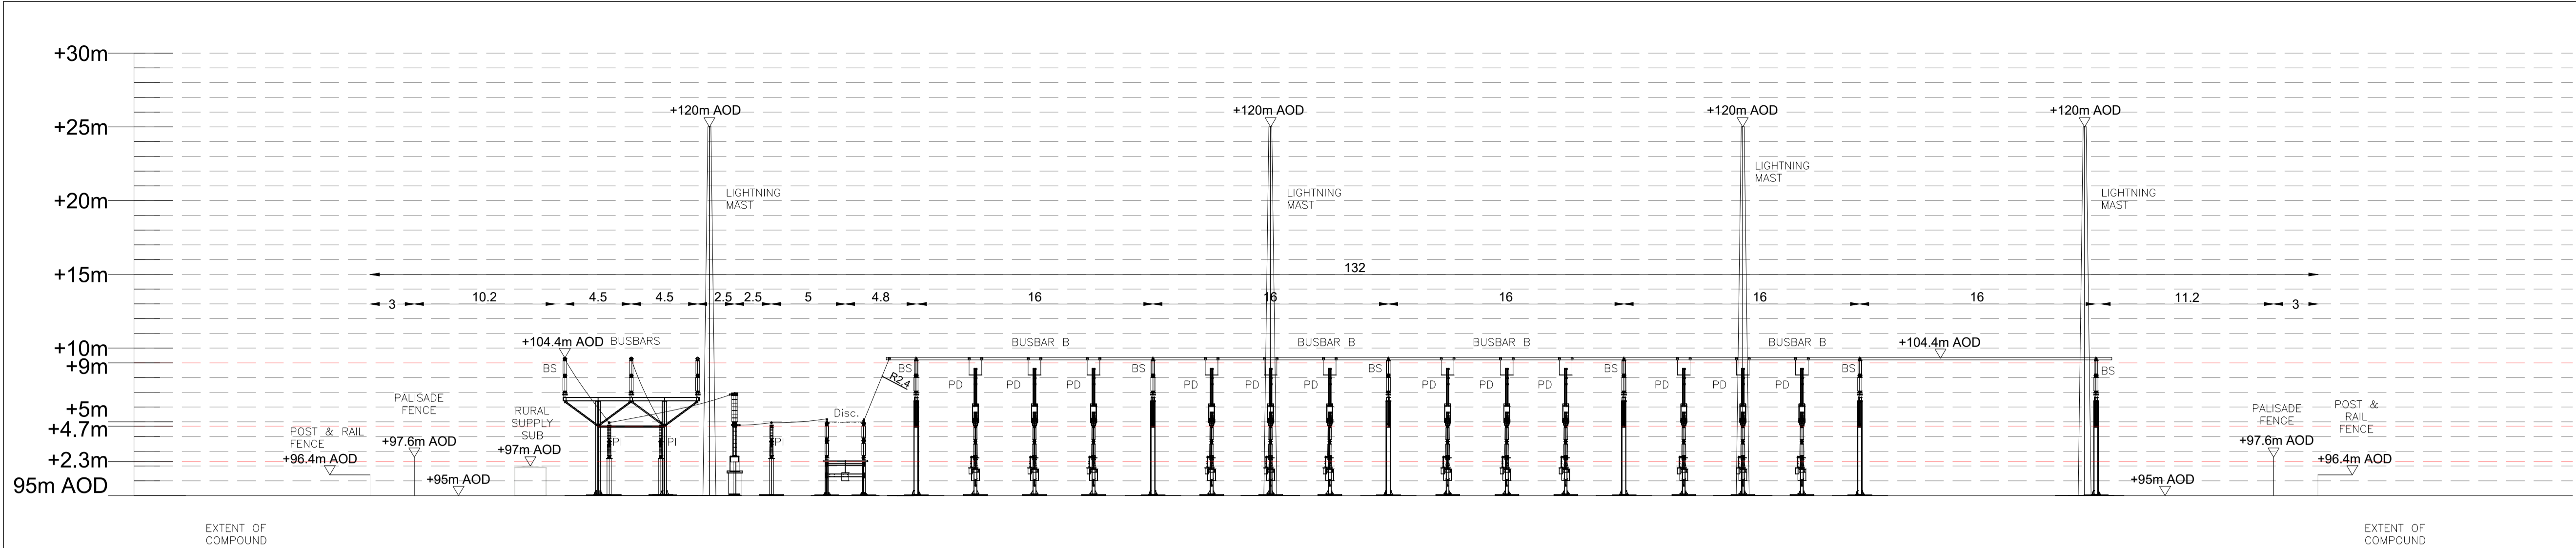

SECTION 1-1
SCALE 1:250

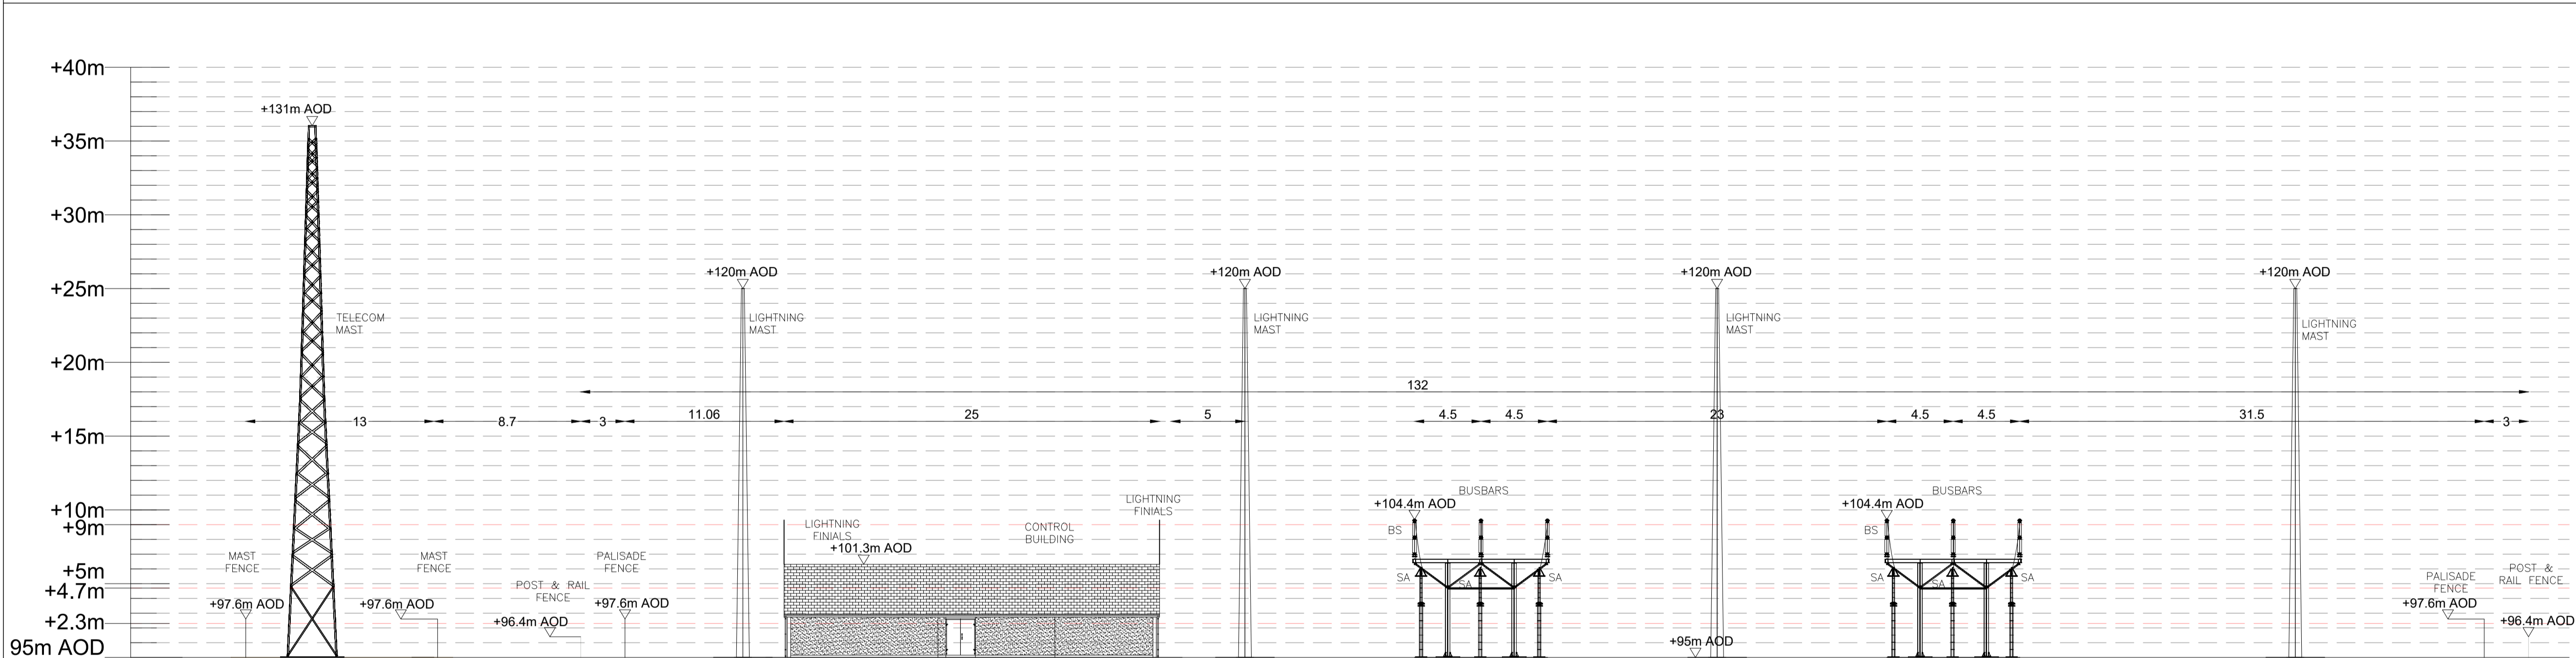

SECTION 2-2
SCALE 1:250

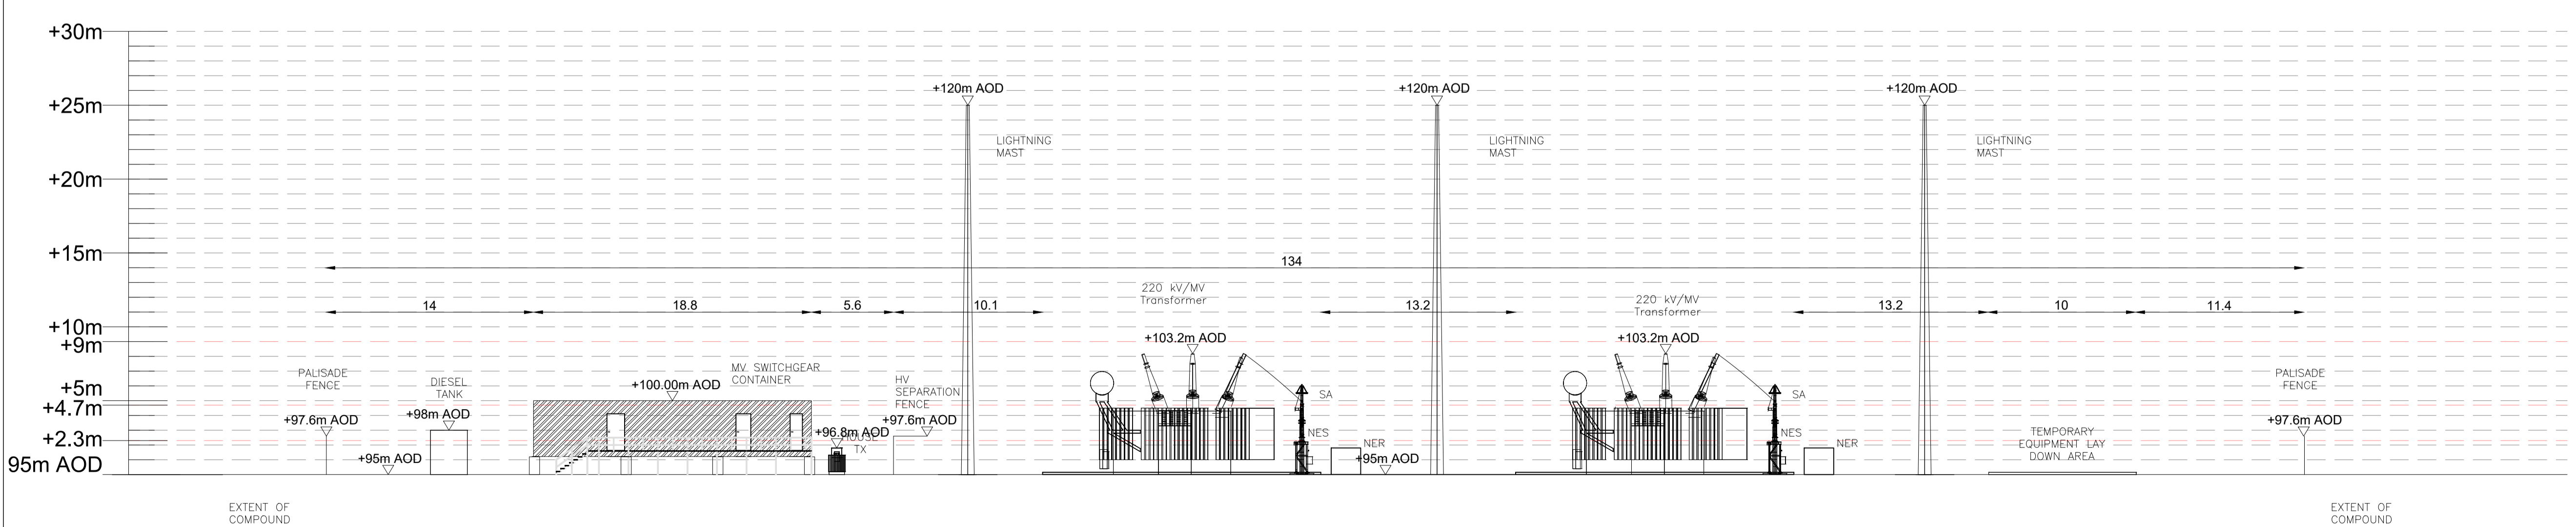

SECTION 3-3
SCALE 1:250

Last saved by: OISIN BURKE (2022-11-09) Last Plotted: 2022-11-09
 Filename: \\NA.AECOM\NET\COM\PLANS\ENGL\HILLPLANNING FOLDER\60657534-ACM-DWG-504.DWG
 Designer: OB
 PM Initials: BW
 Checked: KMCD
 Approved: BW